
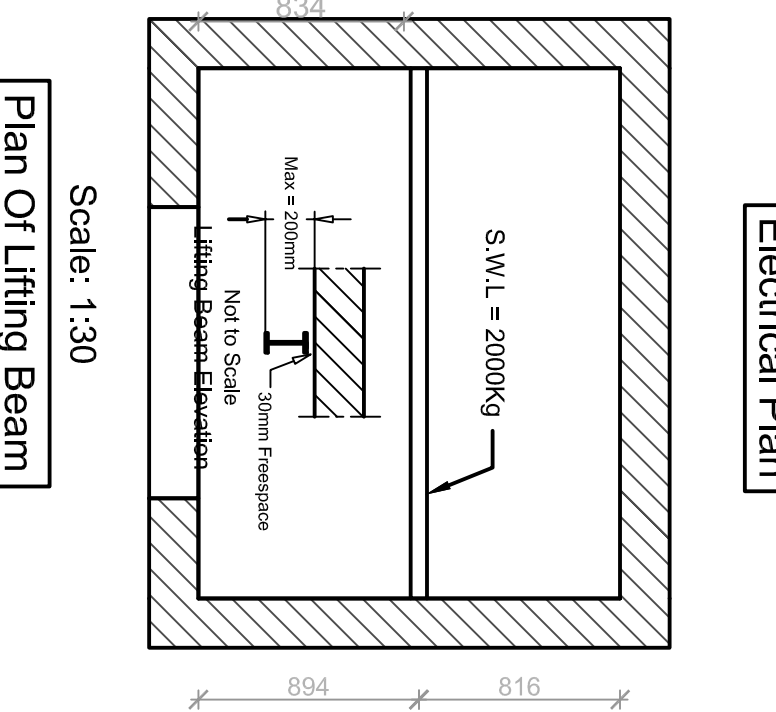
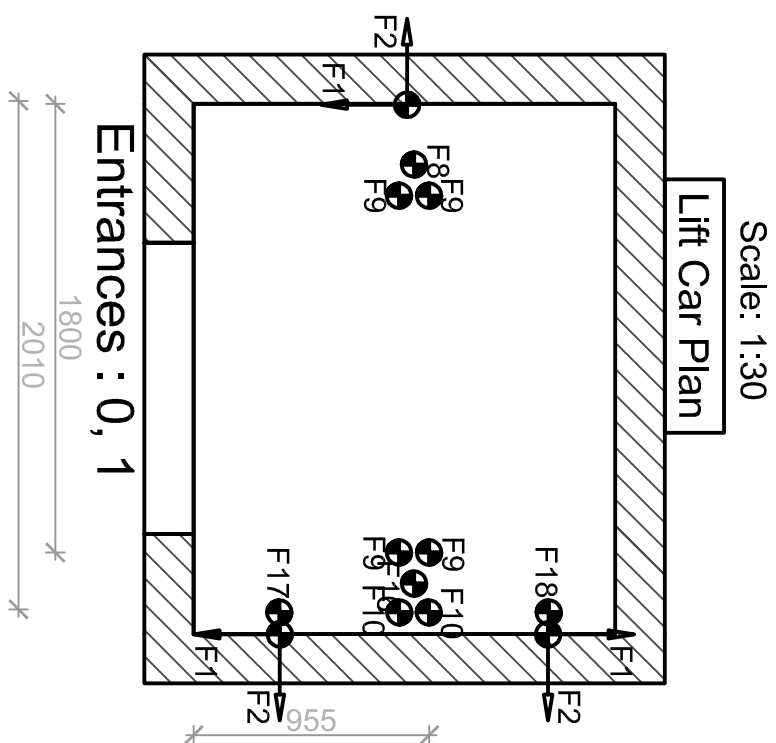


Section A-A 1:75

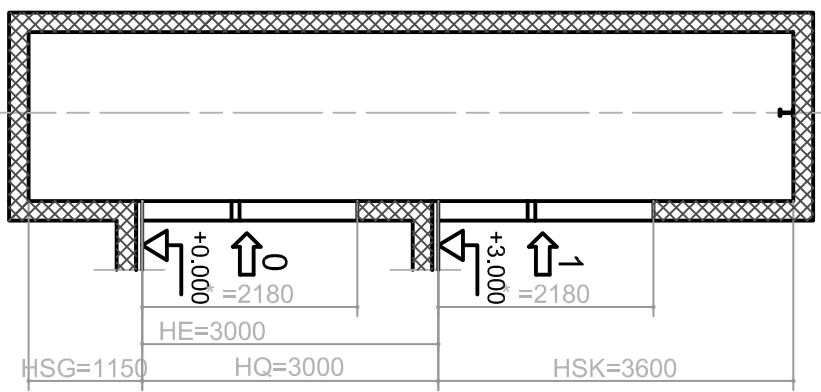

Scale: 1:30
Entrances : 0, 1
Loadings On Pit & Well Walls

Scale: 1:30
Plan Of Lifting Beam

Other technical data: look up "Builders responsibilities"

Ind.	Modification	Name	Date

Loads (N)

F1 = 7947	F5 =	F9 = 20600	F13 =	F17 = 11600
F2 = 1243	F6 =	F10 = 30200	F14 =	F18 = 11600
F3 =	F7 =	F11 =	F15 =	
F4 =	F8 = 33200	F12 =	F16 = 33200	

Load F8 in case of operation of the safely gear.
Loads F9 + F10 in case either car or counterweight lands on the buffers.

ELECTRICAL DATA :

Nominal Voltage (V)	3x400 +N+PE	Nom. power of installation SN	7.7
Main frequency (Hz)	50	Main fuse (building) SIH	25
Voltage and frequency deviation	+10/-10 % Min. cross of supply cable	Max. length of supply cable	4
Power supply for light (V)	230	Total heat generation POW	110
Nom. current of installation INN	17		---
Start. current of installation INA	23		

BUILDER'S WORKPLAN Schindler 5300

Installation place

SAMPLE 13 PERSON 1000kg LIFT

NOT FOR CONSTRUCTION - Schindler Accept no responsibility for works carried out prior to construction issue drawings

Further inquiries concerning this plan on

Drawn	27/04/2007	A3
Comm. No.		
Plan No.	.201	01

Tel: 020 8818 7900 Fax: 020 8818 7879